


**TYPICAL DETAIL  
of  
RUBBER GASKET JOINT**

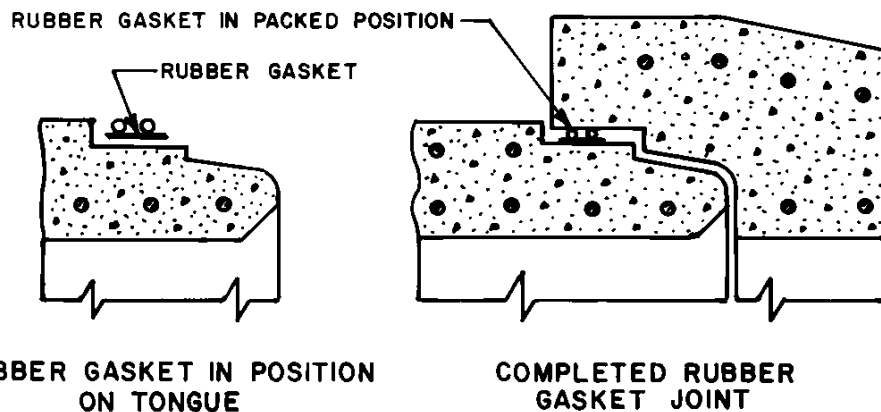

- NOTE:**
1. ALL BACKFILL SHALL BE PLACED IN LAYERS NOT EXCEEDING 150mm IN DEPTH AND EACH LAYER THOROUGHLY COMPACTED AT OPTIMUM MOISTURE CONTENT.
  2. RIP-RAP OF TYPE AS SPECIFIED TO BE PLACED AT CULVERT ENDS.
  3. BEDDING TO BE SHAPED TO CONFORM TO BELL JOINT.

**Alberta**  
TRANSPORTATION  
Engineering Division

DWG. No	CB-6 2.4.M14
	Date
Original	May, 1979
Revised	
Revised	

**TYPICAL  
REINFORCED CONCRETE PIPE  
INSTALLATION  
(RUBBER GASKET JOINT)**